


NOTE:
 CLEANOUTS SHALL BE INSTALLED AT ALL DEAD ENDS AND
 LOCATIONS IN LENGTHS OF PIPE GREATER THAN 300 FEET
 FOR MAINTENANCE PURPOSES.

TRACER WIRE SHALL RUN THE
 FULL LENGTH OF CLEANOUT
 AND BE INSTALLED IN A
 TRACER WIRE ACCESS BOX
 CONFORMING TO EDINA
 STANDARD PLATE 110.

ALL PVC CLEANOUTS SHALL BE
 3-6 INCHES BELOW FINISHED
 GRADE AND HAVE A FITTING
 CLEANOUT - WITH THREADED
 PLUG (SCHEDULE 40).

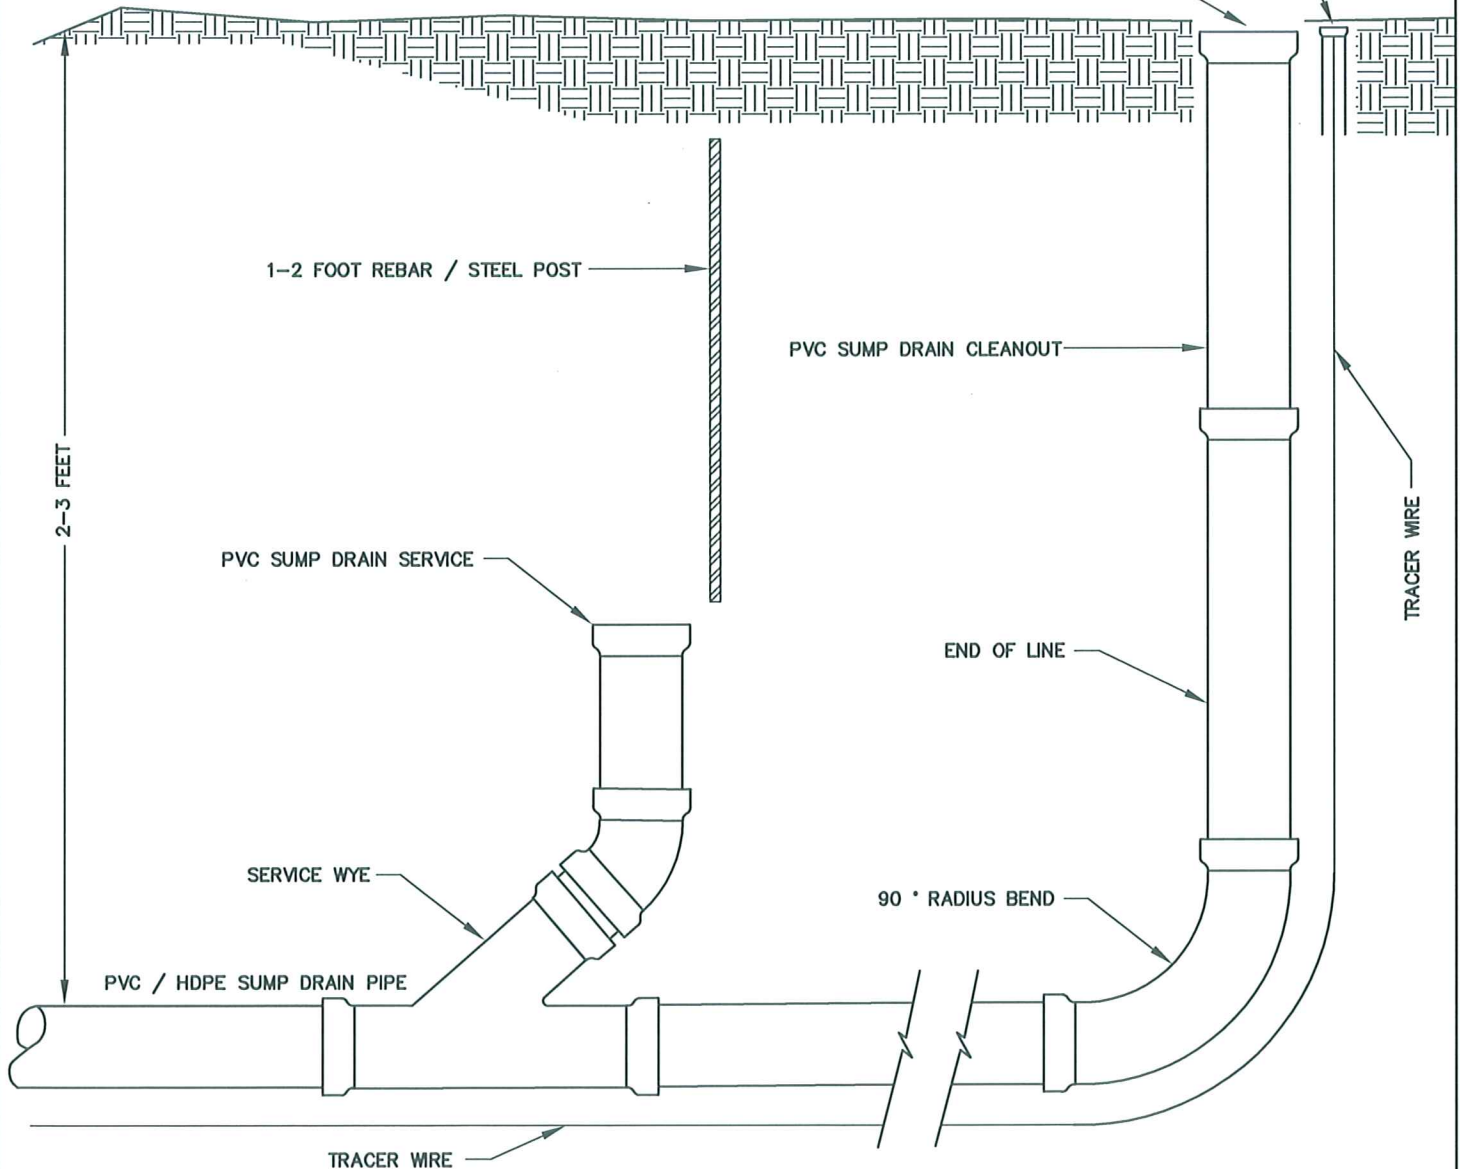

CITY OF EDINA
 ENGINEERING
 & PUBLIC
 WORKS
 DEPTS.

SUMP DRAIN SERVICE & CLEANOUT

Wayne J. Louie
 APPROVED: CITY ENGINEER

REVISED:
 04-09

STANDARD
 PLATE
 241